


GENERAL SPECIFICATIONS FOR WATER SERVICE INSTALLATION

ITEMS 3 THRU 9 INSTALLED BY APPLICANT

Special Notes:

1. Water service line to be installed in separate ditch from gas service and not closer than ten (10) ft. to sewer ditch. **8**
2. Meter to be installed at or near property line.

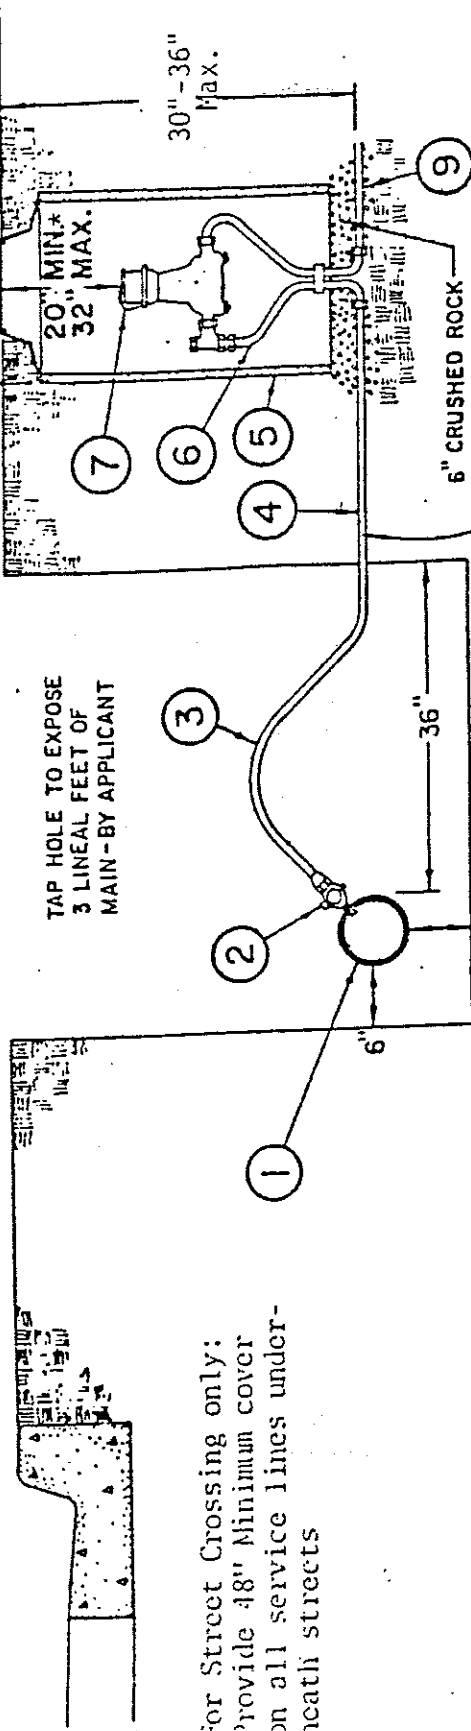

3. For Street Crossing only: Provide 48" Minimum cover on all service lines underneath streets

Type 'K', soft copper pipe to be furnished by Applicant.

1. WATER MAIN
2. CORPORATION STOP
3. GOOSENECK
4. CITY'S SERVICE
5. METER VAULT TILE
6. METER SETTER (SINGLE SERVICE)
7. WATER METER
8. METER VAULT COVER
9. APPLICANT'S SERVICE LINE

* For 12" Setter
16" Min.
22" Max.

OLATHE, KANSAS WATER DEPARTMENT ENGINEERING DIVISION	APPROVED CITY ENGINEER DATE	REVISED	5/8" AND 1" SINGLE WATER SERVICE INSTALLATION	STANDARD PLAN NS-1
--	-----------------------------------	---------	---	--------------------------